


E:\Construction\Standard Details\Del-Co\ID-1 Water Line Embedment.dwg, 1, 12/9/2004 3:14:46 PM, PER



NOTES

1. SUITABLE BEDDING AND INITIAL BACKFILL MATERIAL SHALL CONSIST OF NATURALLY OCCURRING SAND OR CLAY FREE FROM TRASH, ROOTS, DEBRIS, EXCESSIVE MOISTURE AND OBJECTS LARGER THAN  $\frac{3}{4}$ ".
2. PIPE TRENCH WALL SHALL BE VERTICAL TO THE TOP OF THE INITIAL BACKFILL.
3. PROVIDE SELECT FILL No. 8 OR No. 57 STONE FOR BEDDING MATERIAL TO THE DEPTH REQUIRED BY THE WATER UTILITY WHEN UNSTABLE TRENCH BOTTOMS ARE ENCOUNTERED, AS DETERMINED BY THE WATER UTILITY.
4. MANUALLY COMPACT EMBEDMENT MATERIAL FILLING ALL VOIDS AROUND PIPE.
5. TRENCH BACKFILL TYPE SHALL BE PER GENERAL NOTES AND SPECIFICATIONS.

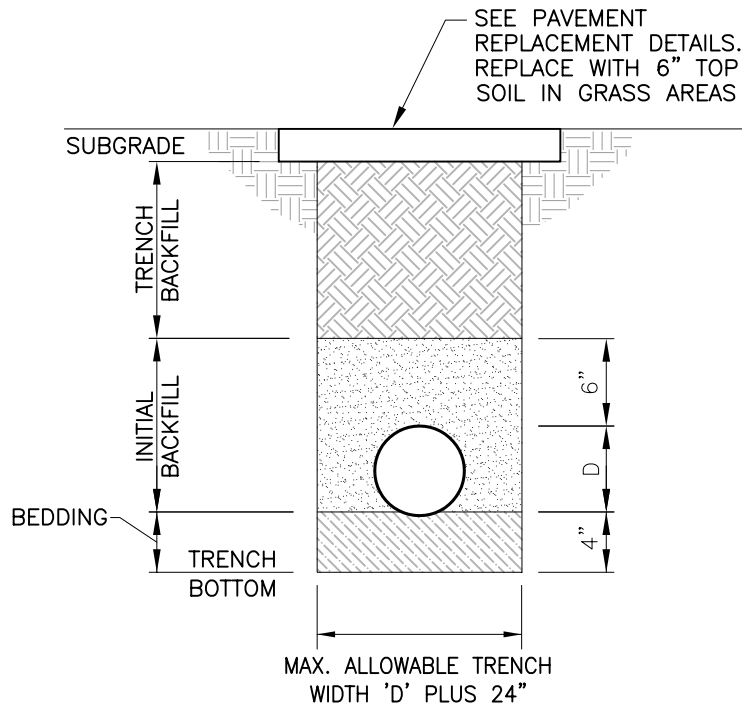

**Del-Co  
Water Co., Inc.**  
6773 OLENTANGY RIVER RD.  
DELAWARE, OH 43015

# WATER LINE EMBEDMENT

REVISED  
01 DEC 04

SCALE  
NTS

PAGE 1 OF 1

D-1