


PLAN
NTS

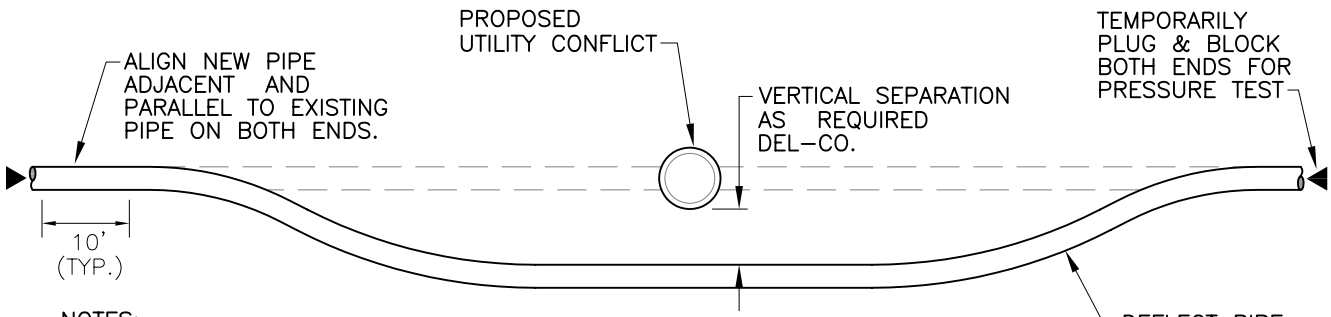

NOTES:

1. NEW WATER LINE SHALL BE CONSTRUCTED, PRESSURE TESTED AND DISINFECTED BEFORE DISRUPTING EXISTING LINE.
2. CONTRACTOR SHALL PERFORM PRESSURE TEST AND DISINFECTION PER DEL-CO SPECIFICATIONS.
3. DEL-CO WILL FLUSH LINE AND PROVIDE BACTERIOLOGICAL TESTING.
4. UPON ACCEPTANCE OF NEW LINE, DEL-CO WILL CONNECT TO EXISTING LINE AT EACH END.

PROFILE
NTS



Del-Co
Water Co., Inc.
6773 OLENTANGY RIVER RD.
DELAWARE, OH 43015

WATER LINE RELOCATION
WITHOUT FITTINGS

REVISED
01 DEC 04

SCALE
NTS

PAGE 1 OF 1

D-6