


E:\Construction\Standard Details\Del-Co\ID-20 Silt Fence.dwg, 1, 12/14/2004 11:48:03 AM, PER

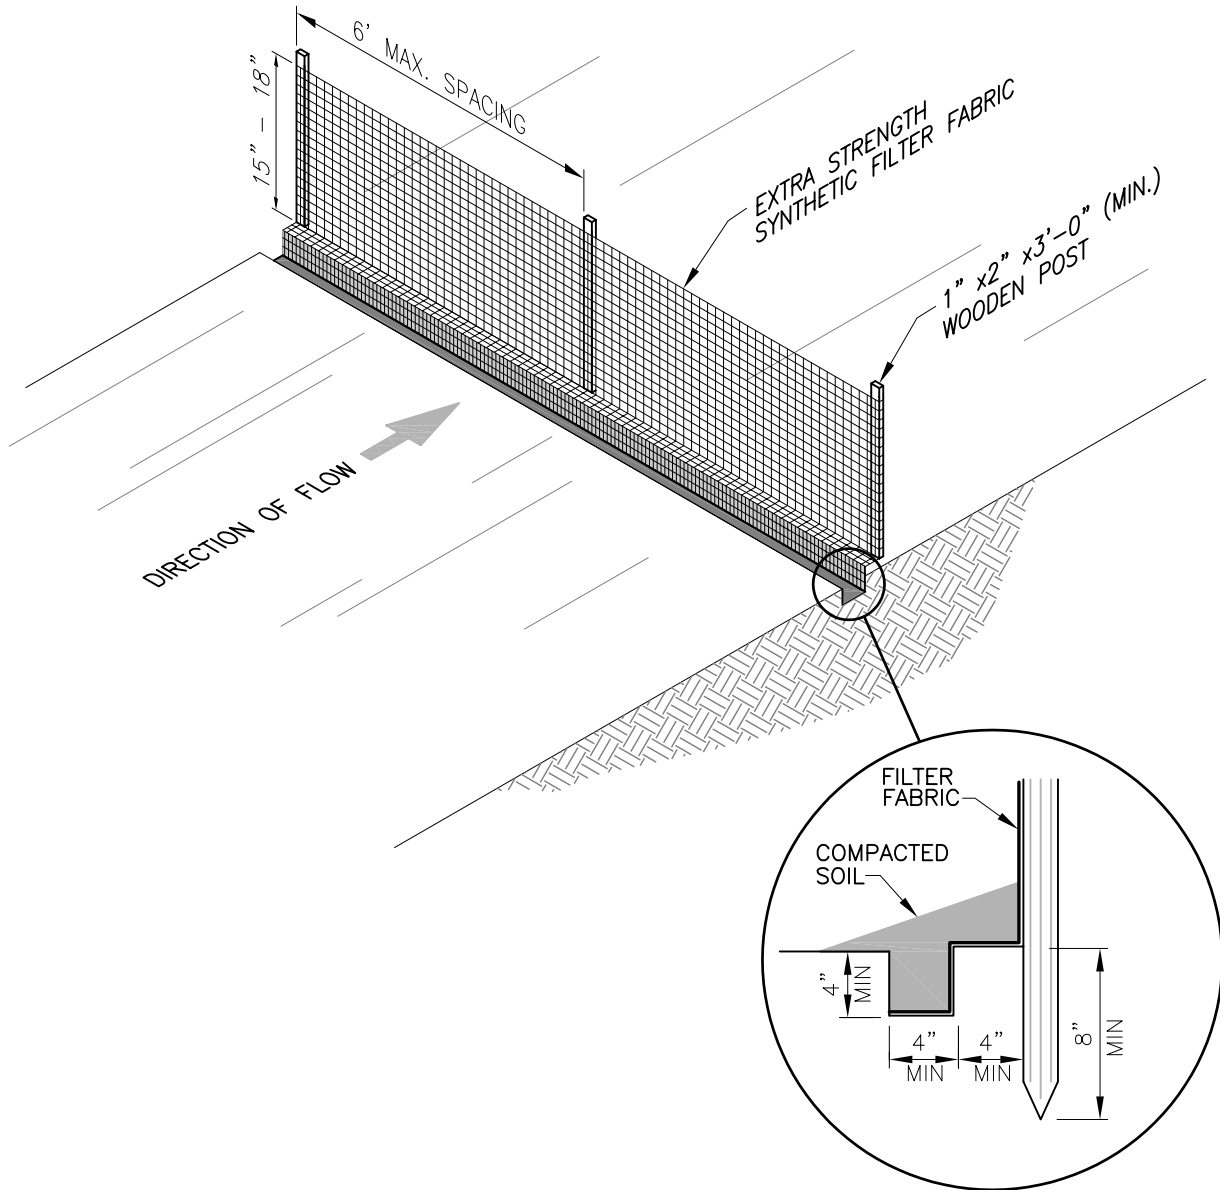

NOTES

FILTER FABRIC SHALL BE FASTENED TO WOODEN POSTS USING 1/2" HEAVY DUTY STAPLES. FILTER FABRIC SHALL BE PLACED IN A CONTINUOUS ROLL TO MINIMIZE THE OCCURRENCE OF JOINTS. WHERE JOINTS CANNOT BE AVOIDED, FABRIC SHALL BE SPLICED TOGETHER AT SUPPORT POSTS, WITH A MINIMUM OF 6 INCH OVERLAP, AND SECURELY SEALED.

ALTERNATELY, A 14 GAUGE WIRE FENCE REINFORCEMENT HAVING A MINIMUM HEIGHT OF 18 INCHES AND A MAXIMUM MESH SPACING OF 6 INCHES MAY BE USED AS A FENCE SUPPORT. IF THE WIRE REINFORCEMENT IS USED, STANDARD STRENGTH SYNTHETIC FILTER FABRIC MAY BE USED AND WOODEN POSTS MAY BE SPACED AT 10 FOOT INTERVALS. THE WIRE REINFORCING SHALL BE BURIED A MINIMUM OF 4 INCHES AND SHALL BE FASTENED TO THE WOODEN POSTS USING 1" HEAVY DUTY STAPLES.

SILT FENCE

NTS



**Del-Co
Water Co., Inc.**
6773 OLENTANGY RIVER RD.
DELAWARE, OH 43015

SILT FENCE

REVISED
01 DEC 04

SCALE
NTS

PAGE 1 OF 1

D-20